



HTS - HTL Series HYDRONIC EXPANSION TANKS

Designed and constructed per ASME Code Section VIII

SUBMITTAL DATA SHEET


MODEL NUMBER	Capacity		B		A		NPT SYSTEM CONNECTION	APPR. WEIGHT	
	Gals	Liters	ins.	mm.	ins.	mm.		lbs.	Kg.
HTS-8	2.0	8	10.6	270	10.2	259	3/4"	21	9.5
HTS-19	5.0	19	10.6	270	19.3	490	3/4"	32	14.5
HTS-30	8.0	30	15.8	400	15.3	389	3/4"	41	18.6
HTS-45	12.0	45	15.8	400	22.4	569	3/4"	52	23.6
HTS-80	21.0	80	15.8	400	34.9	886	1"	78	35.4
HTS-100	26.5	100	19.7	500	37.3	947	1"	83	37.6
HTS-140	37.0	140	19.7	500	43.3	1100	1"	114	51.7
HTL-170	44.0	170	19.7	500	48.7	1,237	1 1/4"	160	72.6
HTL-200	53.0	200	21.7	550	47.2	1,199	1 1/4"	170	77.1
HTL-300	80.0	300	25.6	650	49.0	1,245	1 1/4"	215	97.5
HTL-400	105.0	400	25.6	650	57.9	1,471	1 1/4"	248	112.5
HTL-450	120.0	450	29.5	750	55.8	1,417	1 1/4"	283	128.4
HTL-500	132.0	500	29.5	750	60.1	1,527	2"	341	154.7
HTL-600	160.0	600	25.6	650	88.8	2,256	2"	391	177.4
HTL-800	210.0	800	29.5	750	91.5	2,324	2"	531	240.9
HTL-1000	265.0	1,000	31.5	800	95.5	2,426	2"	561	254.5
HTL-1200	320.0	1,200	35.5	900	100.6	2,555	2"	960	435.4
HTL-1400	370.0	1,400	37.5	950	102.4	2,601	2"	1,040	471.7
HTL-1600	420.0	1,600	41.5	1,050	99.2	2,520	2"	1,183	536.6
HTL-2000	530.0	2,000	43.5	1,105	113.5	2,883	2"	1,318	597.8
HTL-3000	790.0	3,000	51.2	1,300	118.2	3,002	3"	1,865	845.9
HTL-4000	1,060.0	4,000	61.0	1,550	123.0	3,124	3"	2,616	1,186.6
HTL-5000	1,320.0	5,000	63.0	1,600	132.0	3,353	3"	2,892	1,311.8

SPECIFICATIONS
Maximum working pressure 150 PSI (10.5 kg/cm ²)
Maximum operating temp. 240°F (115°C)

Tanks are built in accordance with ASME Section VIII, Division I. Seamless one piece butyl bladder for longer life. Acceptance volume is 90% of stated tank capacity. Epoxy gray finish exterior.

Factory precharge 12 psig (.84 kgf/cm ²)
System connection: Malleable iron HTS-45 thru HTL-2000: bottom connection HTL-3000 thru HTL-5000 available with either top or bottom connection HTS-45 thru HTL-5000: THREADED FEMALE CONNECTION

- A. Total Height
B. Diameter
1. System connection
2. Lifting ring
3. Precharge valve

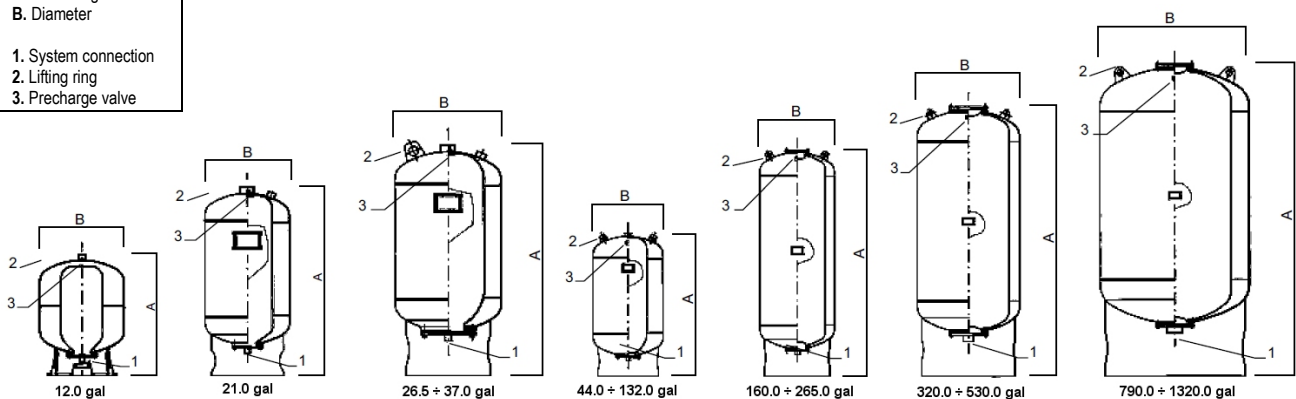

Job Name
Location
Engineer
Contractor
Contractor P.O. Number

Sales representative		
Model number ordered	Qty:	
System operating temperature	Min.	max.
Date submitted		

Dimensional data and weights are approximate
Rev. 06-2012